

BAC06A SWITCH-TYPE BATTERY CHARGER USER MANUAL



SMARTGEN (ZHENGZHOU) TECHNOLOGY CO., LTD.



All rights reserved. No part of this publication may be reproduced in any material form (including photocopying or storing in any medium by electronic means or other) without the written permission of the copyright holder.

Applications for the copyright holder's written permission to reproduce any part of this publication should be addressed to Smartgen Technology at the address above.

Any reference to trademarked product names used within this publication is owned by their respective companies.

SmartGen Technology reserves the right to change the contents of this document without prior notice.

Soliwale version				
Date	Version	Note		
2011-02-15	1.0	Original release.		
2012-08-06	1.1	Modify some units.		
2012-10-31	1.2	Modify the masks.		
2015-0 <mark>5-2</mark> 9	1.3	Modify some parameters, add BAC06V type.		
2017-10-24	1.4	Add battery troubleshooting; modify working humidity range,		
		installation dimensions, and efficiency parameter.		
2020-03-13	1.5	Deleted BAC06V, changed cover picture.		

Software Version



CONTENTS

4	
	2 PERFORMANCE AND CHARACTERISTICS
	3 CHARGING PRINCIPLE
	4 SPECIFICATION
-	5 SETTING
	5.1 VOLTAGE ADJUSTMENT
	5.2 CURRENT ADJUSTMENT
-	
	6.2 TROUBLESHOOTING
	7 CASE DIMENSIONS
7	8 ORDER INFORMATION




1 OVERVIEW

BAC06A switching battery charger adopts the latest switch power components, which is designed for charging lead-acid starting battery according to its property. The charger is suitable for lead-acid battery float charge. The maximum charge current for 12V charger is 6A; the maximum charge current for 24V charger is 3A.

2 PERFORMANCE AND CHARACTERISTICS

Characteristics are as below:

- Designed in switching power structure, wide range of AC voltage input, small volume, light weight and high efficiency;
- Two-stage charging method (constant current firstly and then constant voltage), fully considering charging property of the lead-acid battery, can avoid overcharging and extend the battery life to the fullest;
- With short circuit and reverse connection protection;
- Charging voltage and current can be adjusted via potentiometer on site;
- LED display: Power indication and charging indication;
- Horizontal type for installation of BAV06A, easy to install;

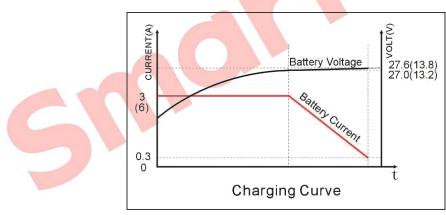

3 CHARGING PRINCIPLE

Chart 1. Charge Principle

According to charging property of the lead-acid battery, battery charger uses 2-stage charging method and charge mode is "constant-current". When battery voltage is under the threshold, it is charging in constant-current mode; when the battery voltage is higher than the threshold, the charging current is decreasing as the battery voltage is rising until it reaches the set voltage, and then charge mode is turned into "floating charge". Charge current is gradually reducing and battery voltage is rising up to the set value. When charging current is lower than 0.3A, the battery is basically fully charged (charging indicator eliminates). Afterwards, charging current will offset self-discharge of the battery and long time charging does no harm to the battery. Thus the charger can not only maintain a full charged condition and but also ensure the battery life.



4 SPECIFICATION

Category	Items	12V	24V	
Input Characteristi	Nominal AC Voltage	AC (95~280)V		
	Max. AC Voltage	AC (90~305)V		
	AC Frequency	50Hz/60Hz		
CS	Max. Input Current	2A		
	Max. Efficiency	85%		
Output Characteristi cs	Charging Current	4A~6A,(Error±2%)	2A~3A,(Error±2%)	
	Factory Charging Current	6A	3A	
	Max. Power	85W		
	Min. Voltage	7.5V		
	No-load Voltage	13.8V, (Error ±1%)	27.6V, (Error ±1%)	
	No-load power consumption	<3W		
Insulation	Insulation Resistance	Between input and output, input and shell both are: DC500V 1min R _L ≥500MΩ		
	Insulation Voltage	Between input and output, input and shell both are: AC1500V 50Hz 1min		
		Leakage current: I _L ≤3.5mA。		
Working Conditions	Working Temperature	(-30∼+55)°C		
	Storage Temperature	(-40∼+85)°C		
	Working Humidity	20%RH~93%RH (No condensation)		
Drafile	Weight	0.65kg		
Profile	Dimension	143mm×96mm×55mm (Length*Width*Height)		

Table 2 Product Parameters

5 SETTING

5.1 VOLTAGE ADJUSTMENT

When adjusting the voltage on the spot, disconnect the battery from the charger, and then measure the output voltage of the charger while adjusting voltage potentiometer (VOLT) to a proper value.

5.2 CURRENT ADJUSTMENT

Connect battery output firstly. When charging voltage is not higher than 25.0V (12.5V) measure charging current; adjust the current potentiometer (AMP) and set proper charge current. Output current can also be estimated according to the current potentiometer scales.



6 OPERATION

6.1 PANEL DRAWING DESCRIPTION



Chart 2. BAC06A

- Terminals L and N connect AC 220V, using multi-strand BVR 1mm² copper wires.
- Terminals B+ and B- connect battery positive and negative, using multi-strand BVR1.5mm² copper wires.
- POWER: Power indicator. When charger works normally, it will illuminate.
- CHARGING: Battery charging indicator. When charging current is over 0.3A, it will illuminate.
- VOLT: Voltage adjustment potentiometer.
- AMP: Current adjustment potentiometer.
- Output 10A fuse. Reverse connection will cause fuse blown. At this time no output voltage; After correcting the connection and changing another fuse, it can continue working.

NOTES:

- 1) Because there is diode and current-limiting circuit inside charger outputs, it can be used together with charging generator in parallel, and there is no need to disconnect the charger at cranking.
- 2) For application on genset, high current will cause voltage drop in charging line, so recommend separately connecting to battery terminal to avoid disturbance on sampling precision.

6.2 TROUBLESHOOTING

6.2.1 FAULT DIAGNOSIS

Output terminal of battery charger short circuit or battery reverse connection may blow the charger output fuse. In that case, after connecting AC power supply, charger green LED lights up but output terminal is without voltage outputting, and then remove the output fuse tube to visually observe whether fuse is blown or not, if condition is permitted, multimeter can be used to measure the fuse status.

- a) If output terminal 10A fuse is blown, users only need to change the same capacity fuse.
- b) If output fuse isn't blown or battery is still without outputting after changing the fuse, battery needs to repair in factory.
- c) Fuse burn emergency method: using conductive metal wire, short connected burnt fuse, and then change a proper fuse later.

6.2.2 PROCEDURES OF CHANGING FUSE

- a) Press hard in on the slotted screwdriver, screw counter-clockwise and then take out the fuse.
- b) Put a new fuse into the block, press the slotted screwdriver and screw clockwise.

NOTE: improper operation or over tightening may damage the block.



7 CASE DIMENSIONS



Chart 3. BAC06A Dimension

8 ORDER INFORMATION

When ordering BAC06A chargers, please choose charger types according to installation and voltage as the chart below:

Table 3 Charger Model

Model	Installation	Battery Type	Rated Output Current
BAC06A-12V	horizontal	12V	6A
BAC06A-24V	horizontal	24V	3A